


Danville Fire Department
P.O. BOX 911, Danville, New Hampshire 03819-0911

Phone: 603-382-5133 Facsimile: 603-382-7352 E-Mail: danvillefd@earthlink.net Emergency: 911

**MINIMUM
CLEARANCES
for
SAFE
INSTALLATION**

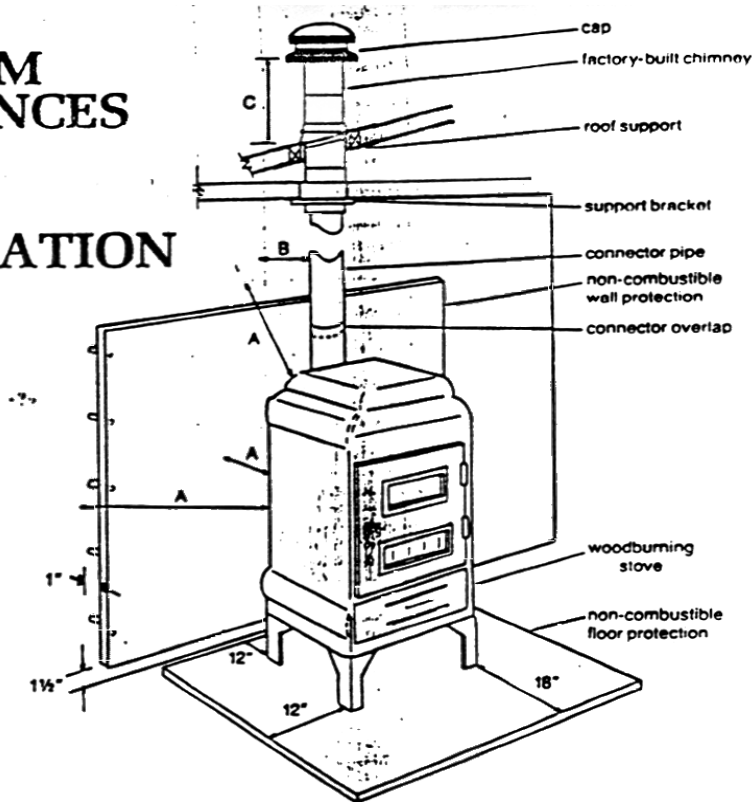

Type of Appliance	Combustible Material	Fire Resistant Panel w/1” Spacing	28 gauge (or heavier) sheet metal with 1” Airspace	4” Brick Veneer with 1” Airspace
A. Radiant Stove				
- Front	36”	-	-	-
- Side, Back	36”	18”	12”	18”
- Top	36”	18”	18”	18”
A. Circulating Stove				
- Front	24”	-	-	-
- Side, Back	12”	6”	4” *	6”
- Top	12”	6”	6” *	6”
B. Single Wall (Connector Pipe 26 gauge or heavier)	18”	12”	9”	8”
C. Chimney Height - Metal or Masonry	Three (3) Feet above any roof surface and Two (2) feet above any roof surface within 10 feet			
Notes: Laboratory verified test clearances permitted. For more details, consult your local building official. NFPA 211. Chimneys, fireplaces, vents and solid fuel burning appliances, 1980. *Building Officials and Code Administrators (BOCA), Basic Mechanical Code. 1981.				

Revised 04/06/2002